



Data Rack Busbar Systems 160A...1000A

### **EAE GROUP IN NUMBERS**





### **Since 1973**

EAE Group of Companies started its journey in the electrical sector in 1973 with the establishment of EAE Elektrik. Since its founding, EAE has grown rapidly, expanding its production and areas of operation by incorporating EAE Lighting in 1983, EAE Machinery in 1996, EAE Electrotechnics in 2004, and EAE Technology in 2009.

EAE carries out its production activities in accordance with ISO 9001 Quality Management, ISO 14001 Environmental Management, ISO 14064-1 Greenhouse Gas Management System, ISO 45001 Occupational Health and Safety Management, ISO 10002 Customer Satisfaction Management, ISO 50001 Energy Management System, and ISO 27001 Information Security Management System standards.







Active Factories



360.000m<sup>2</sup> Enclosed Space



R&D Centers



**150+**Countries Exported To




## **CONTENTS**

Overview	2-5
Technical Characteristics	6-7
Order Code System	8
Standard Lenght & Special Lenght	9
Elbows	10-11
Feeder Box B10	12
Feeder Box B11	13
Tap-Off Boxes	14-17
Installation	
Joint Installation	19
Tap-Off Box Installation	20
Tap-Off Box Horizontal Installation	21
Fixing Elements	
Application I: Threaded Rod with Snap-In Fixing Unit	22
Application II : TMP Ceiling Support with Snap-In Fixing Unit	22
Application III: TMP Ceiling Support and Tray Bracket with Snap-In Fixing Unit	23
Ceiling Mounting Fittings	24
Tray Supports	24
Connection Accessories	25
Measuring a Special Length	26
Busbar Installation Applications	27
Certificates	28
Declaration	29
Product Overview	30


### **Overview**

To power the mission critical IT infrastructures on the Data Rack Cabinets, EAE offers a highly flexible and reliable Busbar System to meet the "Scalability" challenge in the Data Centers finding the way to Moves, Adds and Changes (MACs).

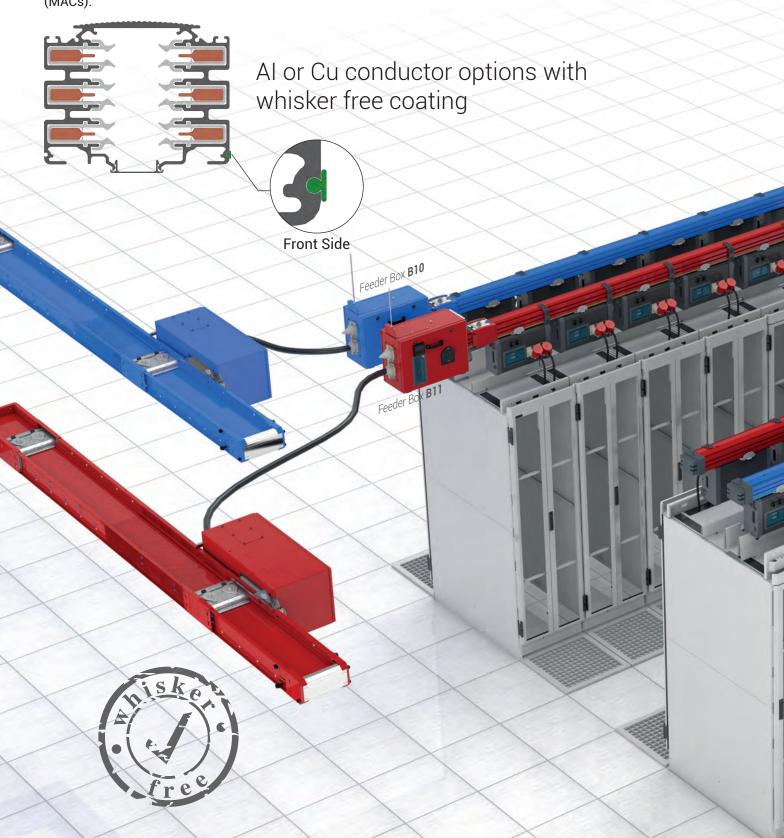


Whisker free and tin plated solid form conductors ensure for better heat dissipation, higher short circuit values and longer operation life while significantly contributing to the "Availability" challenge in the data center environments



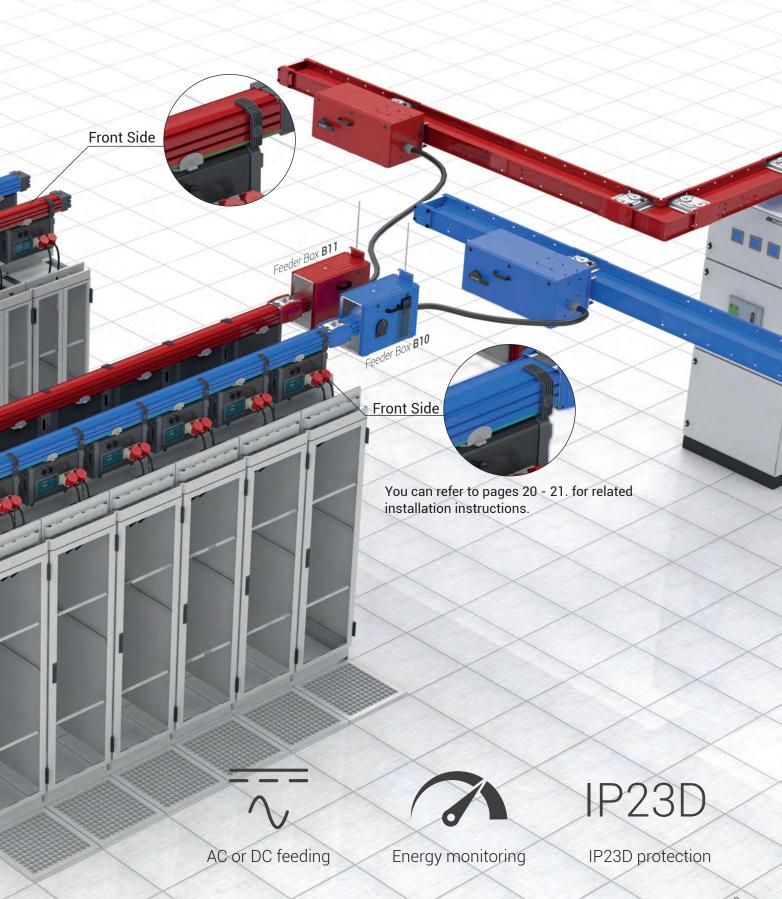





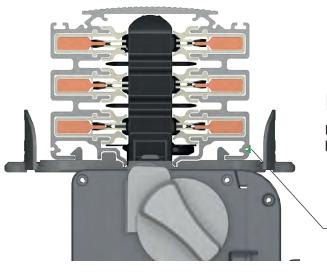

### Plug-n-Play

Easy plug-in Tap-Off Boxes on any point along the busbar, remove and relocate wherever necessary





### Tap-Off Contacts

Constant contact pressure with double sided spring system and safe locking mechanism on Tap-Off Box contacts





### Snap-In Suspension Mechanism

Easy and fast structural mounting thanks to Snap-In Fixing Unit

### Overview



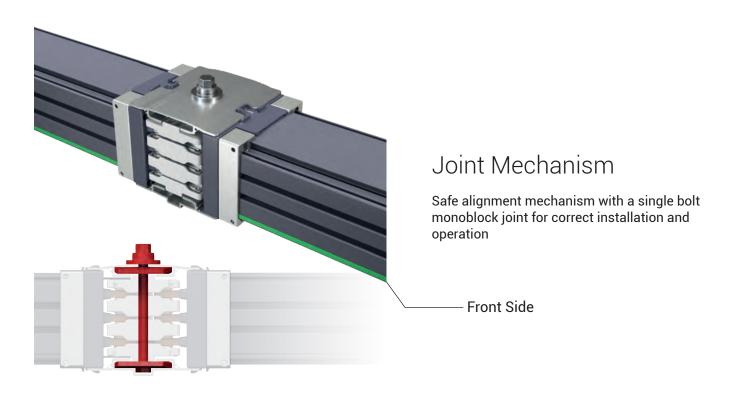

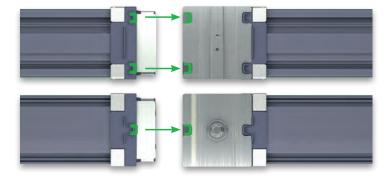




## Easy and Safe Installation

Patented EAE Alignment Solution, ideal alignment of the block joint element and busbar thanks to the alignment guides on the joint area

### **Technical Characteristics**



Standards	IEC 61439-6, TS EN 61439-6, IEC 61439-1, TS EN 61439-1
Rated Isolation Voltage	Ui: 1000 V at Cat IV
Max. Rated Operational Voltage	Ue: 1000 Vac
Rated Impulse Withstand Voltage	Uimp: 12 kV
Rated Frequency	f: 50 Hz
Pollution Degree	III W
Protection Degree	IP23D
External Mechanical Impacts (IK Code)	IK08
Protection for Safety	Basic Protection (HD 60364-4-41 Clause 41)



	Basic Protection (HD 60364-4-4	1 Clause A1)		ڪ			_	
Trocodion for durety	Dusto Frotestion (Fib 00004 4 4	i, olddoc Air				Al		
RATED CURRENT		In	Α	160	250	400	630	800
BUSBAR CODE				01	02	04	06	08
MEAN PHASE CONDUCTOR CHARACTERISTICS AT	RATED CURRENT	ENT In						
Resistance at a conductor temperature of 20 °C		R <sub>20</sub>	mΩ/m	0,358	0,352	0,234	0,159	0,115
Average resistance at In, thermal balance		R	mΩ/m	0,403	0,426	0,299	0,220	0,156
Reactance (Independent from Temperature)		X	mΩ/m	0,098	0,100	0,087	0,077	0,064
Positive and negative sequence impedances at an ambie	ent air temperature of 35 °C	Z	mΩ/m	0,415	0,437	0,311	0,233	0,168
Positive and negative sequence impedances at a conduc		Z <sub>20</sub>	mΩ/m	0,371	0,366	0,249	0,177	0,131
Rated Power Loss at In	, , , , , , , , , , , , , , , , , , ,	20	W/m	30,1	76,9	140,0	252,4	299,5
Aluminium Housing Section (Aluminium)			mm²	3302	3302	3302	3302	3302
Busbar Weight (4 Conductors)			kg/m	11,1	11,1	12,3	12,6	16,3
Busbar Weight (5 Conductors)			kg/m	11,4	11,4	11,8	13,3	17,3
Busbar Weight (6 Conductors)			kg/m	11,6	11,6	12,3	14,0	18,3
MEAN FAULT-LOOP CHARACTERISTICS			Kg/III	11,0	11,0	12,0	1 1,0	10,0
ZERO-SEQUENCE IMPEDANCE								
Zero-sequence impedance at a conductor temperature of	of 20 °C	Z <sub>(0)b20phN</sub>	mΩ/m	1,482	1,482	1,016	0,725	0,538
Zero-sequence impedance at a conductor temperature of		Z(0)b20phPE	mΩ/m	0,701	0,701	0,350	0,287	0,193
Zero-sequence impedance at a conductor temperature of		Z <sub>(0)b20ph2N</sub>	mΩ/m	0,988	0,988	0,686	0,510	0,368
Zero-sequence impedance at a conductor temperature of		Z(0)20phCPE	mΩ/m	1,509	1,509	1,039	0,743	0,518
Zero-sequence impedance at an ambient temperature of		Z(0)bphN	mΩ/m	1,659	1,775	1,272	0,968	0,699
Zero-sequence impedance at an ambient temperature of		Z(0)bphPE	mΩ/m	0,787	0,844	0,441	0,389	0,255
Zero-sequence impedance at an ambient temperature of	` 5/	Z(0)bph2N	mΩ/m	1,106	1,184	0,856	0,680	0,479
Zero-sequence impedance at an ambient temperature of	,	Z <sub>(0)bphCPE</sub>	mΩ/m	1,689	1,807	1,300	0,989	0,672
RESISTANCES AND REACTANCES	()	-(U)DPITCE	,	,,,,,,,	.,	.,	-,	7,212
Resistance at a conductor temperature of 20 °C		R <sub>b20phph</sub>	mΩ/m	0,722	0,722	0,483	0,346	0,251
Resistance at a conductor temperature of 20 °C		Rb20phN	mΩ/m	0,718	0,718	0,479	0,342	0,248
Resistance at a conductor temperature of 20 °C (Double	Notr)	Rb20ph2N	mΩ/m	0,558	0,558	0,373	0,274	0,192
Resistance at a conductor temperature of 20 °C (Housin	,	R <sub>b20phPE</sub>	mΩ/m	0,473	0,473	0,271	0,207	0,143
Resistance at a conductor temperature of 20 °C (CPE)	57	Rb20phCPE	mΩ/m	0,723	0,723	0,485	0,343	0,236
Resistance at an ambient air temperature of 35 °C		Rbphph	mΩ/m	0,815	0,875	0,618	0,479	0,340
Resistance at an ambient air temperature of 35 °C		RbphN	mΩ/m	0,809	0,869	0,613	0,473	0,337
Resistance at an ambient air temperature of 35 °C (Doub	ole Notr)	R <sub>bph2N</sub>	mΩ/m	0,629	0,676	0,478	0,378	0,261
Resistance at an ambient air temperature of 35 °C (House		R <sub>bphPE</sub>	mΩ/m	0,533	0,572	0,347	0,286	0,194
Resistance at an ambient air temperature of 35 °C (CPE)		RbphCPE	mΩ/m	0,815	0,875	0,620	0,475	0,320
Reactance (Independent from temperature)			mΩ/m	0,194	0,194	0,169	0,142	0,118
Reactance (Independent from temperature)		Xbphph	mΩ/m	0,199	0,199	0,170	0,140	0,116
Reactance (Double Notr) (Independent from temperature	a)	X <sub>bphN</sub> X <sub>bph2N</sub>	mΩ/m	0,152	0,152	0,135	0,114	0,089
Reactance (Housing) (Independent from temperature)	-)	X <sub>bphPE</sub>	mΩ/m	0,103	0,103	0,086	0,075	0,060
Reactance (CPE) (Independent from temperature)			mΩ/m	0,199	0,199	0,173	0,145	0,113
SHORT CIRCUIT RATING		X <sub>bphCPE</sub>	11152/111	0,199	0,155	0,113	0,143	0,113
Rated Short-time Withstand Current (1s) (Three phase)		lcw	kA	10	10	20	25	25
Rated Peak Withstand Current		lpk	kA	17	17	40	52,5	52,5
Rated Short-time Withstand Current for Neutral Conduct	tor(1e)(Single phase)	lcw	kA	6	6	12	15	15
Rated Peak Withstand Current for Neutral Conductor	tor(19)(Single phase)	lpk	kA kA	10,2	10,2	24	30	30
Rated Short-time Withstand Current for PE (Housing) Co	anductor(1e)(Single phase) siirali akum)		kA		6		15	15
Rated Peak Withstand Current for PE (Housing) Conduct		lcw		6	10,2	12	30	30
Rated Short-time Withstand Current for PE (Housing) Conductor(		lpk	kA kA	10,2		24		
,	15)(Single phase)	lcw		6	6	12	15	15
Rated Peak Withstand Current for CPE Conductor		lpk	kA	10,2	10,2	24	30	30
Short Circuit Conditional Rating (KAIC) at 415V		lcc	kA	70	70	70	70	70

### **Technical Characteristics**



Cu							
250	400	630	800	1000			
02	04	06	08	10			
0,215	0,211	0,140	0,101	0,080			
0,246	0,274	0,198	0,139	0,107			
0,100	0,101	0,090	0,077	0,070			
0,265	0,292	0,218	0,159	0,127			
0,237	0,234	0,167	0,127	0,105			
43,7	127,5	228,3	257,0	321,0			
3302	3302	3302	3302	3302			
13,6	13,6	11,6	14,3	26,43			
14,6	14,6	13,0	17,0	29,68			
15,3	15,3	14,3	18,3	32,94			

0,682

0,501

0,949

0,949

10,8

21,6

10,8

21,6

70

10,8

21,6

10,8

21,6

70

0,363

0,545	0,545	0,002	0,301	0,303
0,367	0,367	0,292	0,193	0,151
0,649	0,649	0,485	0,358	0,282
0,962	0,962	0,707	0,518	0,374
1,063	1,191	0,902	0,636	0,445
0,416	0,470	0,400	0,256	0,195
0,727	0,814	0,643	0,456	0,348
1,077	1,206	0,934	0,659	0,456
0,433	0,433	0,305	0,222	0,156
0,434	0,434	0,301	0,219	0,153
0,340	0,340	0,241	0,178	0,130
0,261	0,261	0,192	0,136	0,100
0,427	0,427	0,305	0,223	0,155
0,494	0,562	0,430	0,305	0,207
0,496	0,564	0,424	0,301	0,203
0,389	0,442	0,339	0,245	0,173
0,298	0,339	0,271	0,187	0,133
0,488	0,555	0,430	0,307	0,206
0,196	0,196	0,170	0,143	0,112
0,197	0,197	0,170	0,141	0,111
0,157	0,157	0,137	0,113	0,090
0,102	0,102	0,088	0,072	0,054
0,214	0,214	0,174	0,146	0,115
18	18	25	40	40
36	36	53	84	84
10,8	10,8	15	24	24
21,6	21,6	30	50,4	50,4

15

30

15

30

70

24

50,4

24

50,4

70

24


50,4

24


50,4


70

#### Housing Type 1: 160A...630A (AI); 250A...800A (Cu)

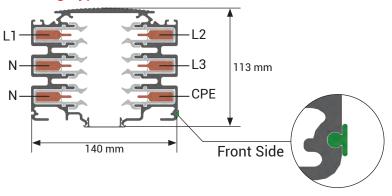


### Housing Type 2: 1000A (Cu)

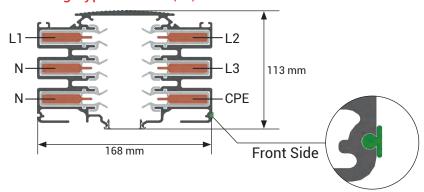

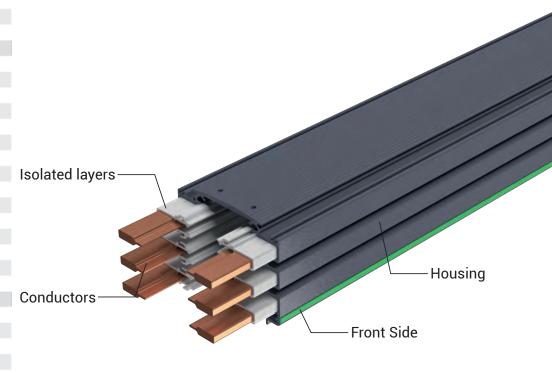

### **Order Code System**



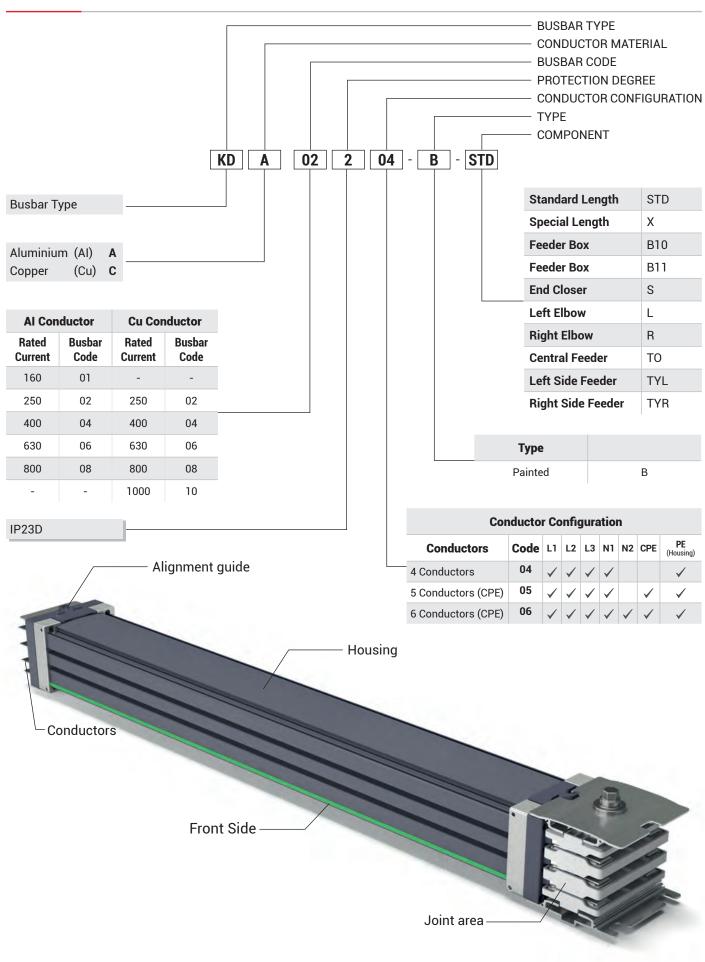


### **Standard Straight Length**



### **Standard Length**

Sample Order: 250 A, Aluminium, IP23D, 6 Conductors, Painted

KDA 02206-B-STD

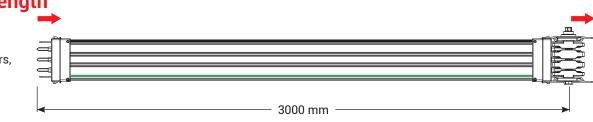

Housing Type 1: 160A...630A (AI); 250A...800A (Cu)

Housing Type 2: 1000A (Cu)

### **Special Length**


Sample Order: 250 A, Aluminium, IP23D, 6 Conductors, Painted

KDA 02206-B-X

X=1500 mm.

Note:

Minimum Length (X)=650 mm.




Housing Type 1: 160A...630A (AI); 250A...800A (Cu)

Housing Type 2: 1000A (Cu)

### **Aluminium Closure Panel**

Standard length= 2800 mm




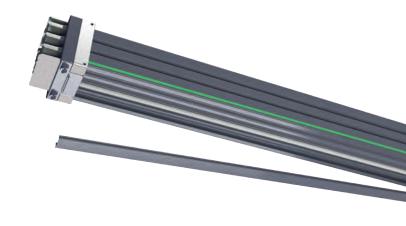

### **End Closer (S)**

It is used to close the end of the busbar run and included on all standard and special length of busbars.




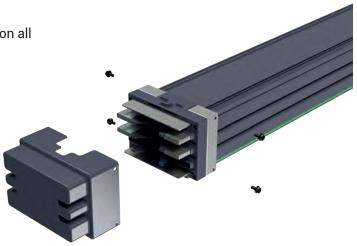


### **Order Code System**





### **Left Elbow (L)**

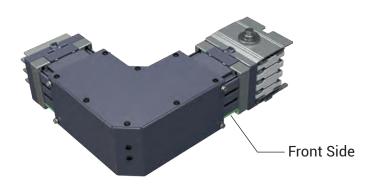



### Right Elbow (R)

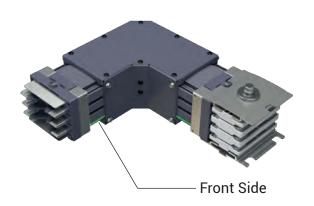



Housing Type 1: 160A...630A (AI); 250A...800A (Cu)

Note: Please consider the conductor type for your project. There is no seperate order code, one code covers each ampacity.

A

Housing Type 2: 1000A (Cu)

Note: Please consider the conductor type for your project. There is no seperate order code, one code covers each ampacity.

	A (mm)	B (mm)	D (mm)	W (mm)
Housing Type 1	417	347	274	140
Housing Type 2	431	347	288	168





Tap-off boxes cannot be installed on elbows.

### **Standard Straight Length**





### **Central Feeder (TO)**

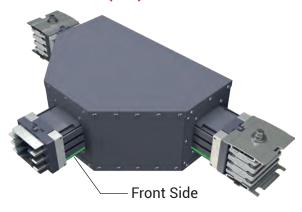

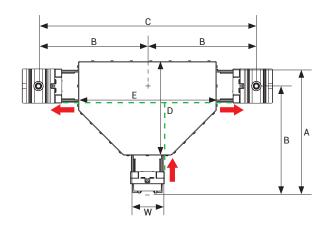



### **Left Side Feeder (TYL)**



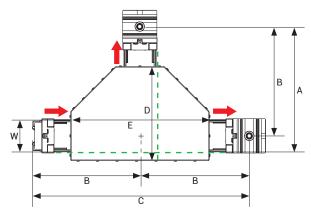

### **Right Side Feeder (TYR)**

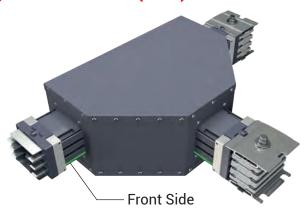

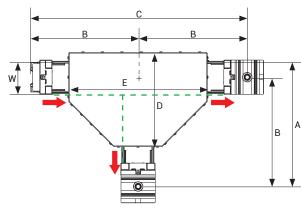

Housing Type 1: 160A...630A (AI); 250A...800A (Cu)

Note: Please consider the conductor type for your project. There is no seperate order code, one code covers each ampacity.

Housing Type 2: 1000A (Cu)

Note: Please consider the conductor type for your project. There is no seperate order code, one code covers each ampacity.

	A (mm)	B (mm)	C (mm)	D (mm)	E (mm)	W (mm)
Housing Type 1	548	478	956	411	606	140
Housing Type 2	562	478	956	425	606	168



Tap-off boxes cannot be installed on elbows.

### Feeder Boxes 160A...630A (Al), 250A...1000A (Cu)




Feeder Box (B10)


Orientation : Right → Left


The busduct runs from the right side to the left side when connected to the End Feed Box.



\* Support the feeder units from corresponding junction points.









Housing Type 1: 160A...630A (AI); 250A...800A (Cu)

Note: Please consider the conductor type for your project. There is no seperate order code, one code covers each ampacity.



Housing Type 2: 1000A (Cu)

Note: Please consider the conductor type for your project. There is no seperate order code, one code covers each ampacity.

	A (mm)	W (mm)
Housing Type 1	260	140
Housing Type 2	288	168

- Hinged and easily removable cover
- IR window (optional)
- Energy Monitoring (optional)



Tap-off boxes cannot be installed on feeder boxes.

- \* Please contact us for special feeder boxes.
- \* All dimensions in mm.

### Feeder Boxes 160A...630A (AI), 250A...1000A (Cu)



Feeder Box (B11)

Orientation : Left → Right

The busduct runs from the left side to the right side when connected to the End Feed Box.

\* Support the feeder units from corresponding junction points. 0



Housing Type 1: 160A...630A (AI); 250A...800A (Cu)

Note: Please consider the conductor type for your project.

There is no seperate order code, one code covers each ampacity.



Housing Type 2: 1000A (Cu)

Note: Please consider the conductor type for your project.

There is no seperate order code, one code covers each ampacity.

	A (mm)	W (mm)
Housing Type 1	260	140
Housing Type 2	288	168

- Hinged and easily removable cover
- IR window (optional)
- Energy Monitoring (optional)

^

Tap-off boxes cannot be installed on feeder boxes.

- \* Please contact us for special feeder boxes.
- \* All dimensions in mm.

### **Tap-Off Boxes**

### **BUSBAR TYPE** BOX TYPE RATED CURRENT PROTECTION 125 A - 12 DEGREE CONDUCTOR 4 Conductors -4 5 Conductors -5 6 Conductors -6 KD **Plug-in Tap-off Boxes**



# **KDP Terminal Box (80A)**






Sample Order:

5 Conductors

**KDP 1225** 

Plug-in / 125 A / IP-23D

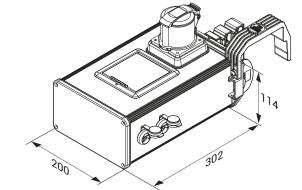


### **Type 02**




Type 03



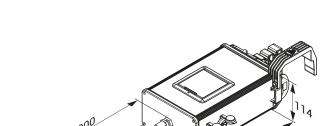

16A/32A Single & Three Phase Circuit Breaker 16A/32A, 3P & 5P Socket / Connector with cable RJ45 Ports (Optional for Energy Metering)

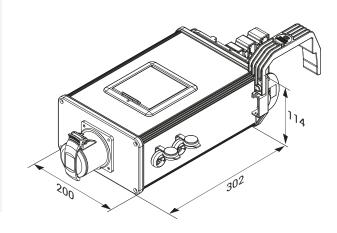

- \* Please contact us for special boxes.
- \* All dimensions in mm.



The KD tap off box conductors number should be selected based on the number of conductors defined by the busbar project design.


### **Tap-Off Boxes**



### **KDP Single Socket Box (125A)**




16A/32A Single & Three Phase Circuit Breaker 63A Three Phase Circuit Breaker 16A/32A Single & Three Phase Socket 63A Three Phase Socket RJ45 Ports (Optional for Energy Metering)

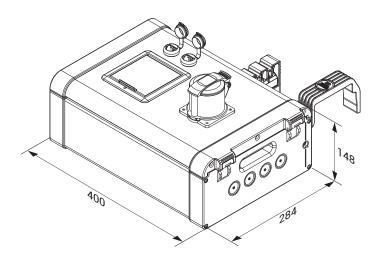

### **KDP Double Socket Box (125A)**

16A/32A Single & Three Phase Circuit Breakers 16A/32A Single & Three Phase Sockets RJ45 Ports (Optional for Energy Metering)



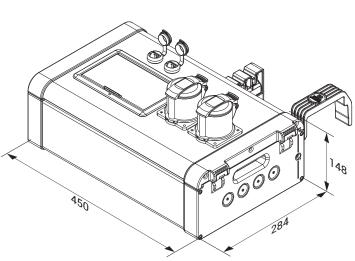

- \* Please contact us for special boxes.
- \* All dimensions in mm.

The KD tap off box conductors number should be selected based on the number of conductors defined by the busbar project design.


### **Tap-Off Boxes**



### **KDP Energy Analyzer Box (125A)**




16A/32A Single & Three Phase Circuit Breakers 63A Three Phase Circuit Breaker 16A/32A Single & Three Phase Socket 63A Three Phase Socket **Energy Analyzer with Display** RJ45 Ports

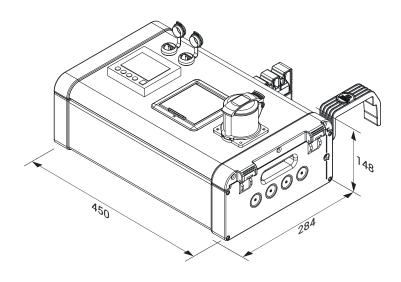

### **KDP Empty Box (125A)**



Configurable up to 12 modules with RJ45 ports with optional cable gland feed.

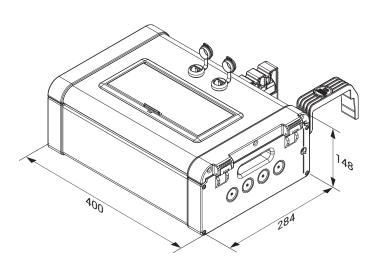

- \* Please contact us for special boxes.
- \* All dimensions in mm.



The KD tap off box conductors number should be selected based on the number of conductors defined by the busbar project design.


### **Tap-Off Boxes**




### **KDP Energy Analyzer Box Horizontal (125A)**




16A/32A Single & Three Phase Circuit Breakers 63A Three Phase Circuit Breaker 16A/32A Single & Three Phase Socket 63A Three Phase Socket **Energy Analyzer with Display RJ45 Ports** 

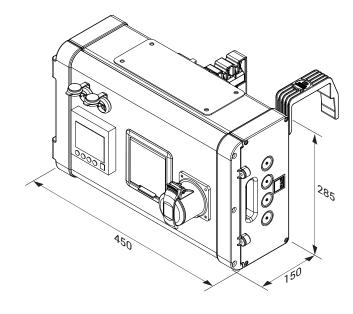


### **KDP Empty Box Horizontal (125A)**





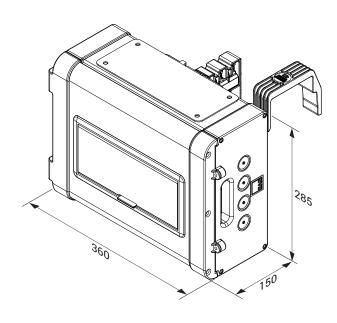

- \* Please contact us for special boxes.
- \* All dimensions in mm.







### Installation

### **Joint Installation**




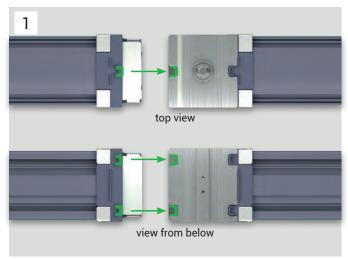


Align the busbars those with and without block joints facing each other and insert together

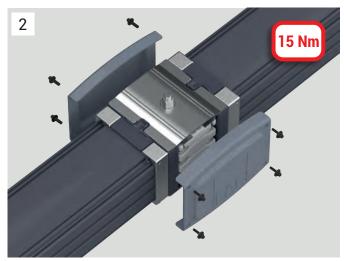

Assemble the joint cover and tighten the cover bolts

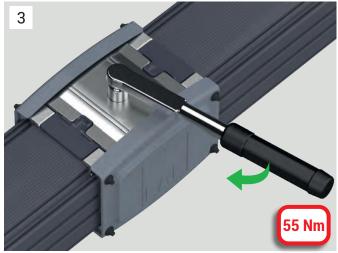

Adjust the torque wrench to **55 Nm** and tighten the joint

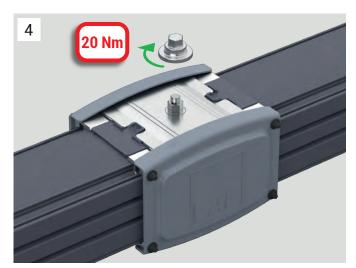

Mount the nut locking piece on the nut


#### Installation

#### **Tap-Off Box Installation**






Ensure that the locking latch position is set right (as indicated), setup the installation mechanism by pressing on the claws. If this step is not made, the box contact set may be demaged as a result of any force.

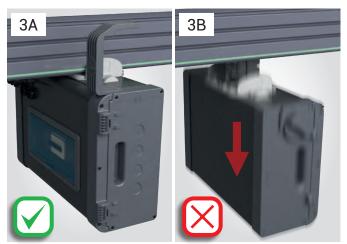


Assure that the box is inserted and locked inside the busbar slot



Ensure that the mounting angle is correctly attached on the busbar housing

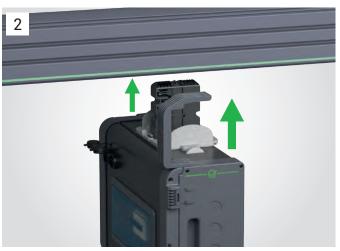

Insert the box inside the slot of the busbar by facing the mounting angle, the box label and the housing 'green' reference line on the same side. Do not install or remove Plug-in units under load. Make sure breakers are in the off position

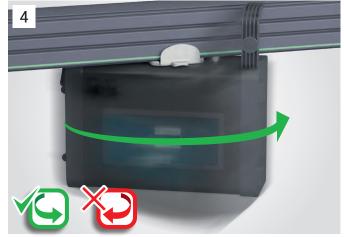

Engage the top off box by rotating in the direction of the arrow. Do not rotate the box against the direction of the arrow.




Secure the box by turning the locking latch in direction of the arrow

Notes: For the purpose of ensuring earth continuity, the installation of the upper mechanism onto the busbar may cause minor paint imperfections on the top part of the box. These imperfections are solely cosmetic and do not affect the electrical or mechanical performance of the product.


#### Installation

#### **Tap-Off Box Horizontal Installation**




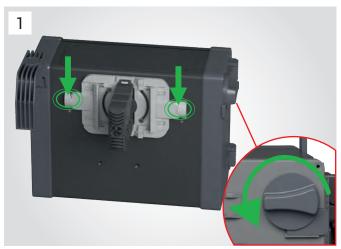


Ensure that the locking latch position is set right (as indicated), setup the installation mechanism by pressing on the claws.

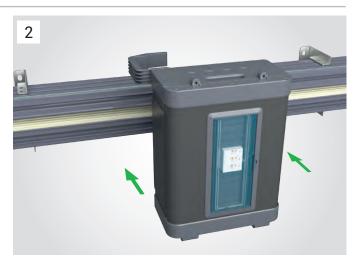

Insert the box inside the slot of the busbar by facing the mounting angle, the box label and the housing 'green' reference line on the same side. Do not install or remove Plug-in units under load. Make sure breakers are in the off position

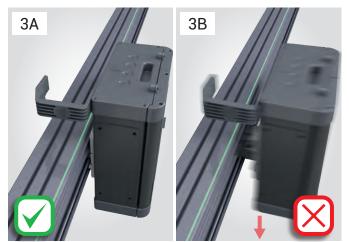

Assure that the box is inserted and locked inside the busbar slot

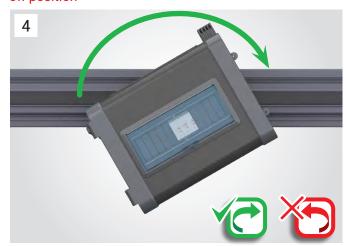

Engage the top off box by rotating in the direction of the arrow. Do not rotate the box against the direction of the arrow



Ensure that the mounting angle is correctly attached on the busbar housing




Secure the box by turning the locking latch in direction of the arrow.

Notes: For the purpose of ensuring earth continuity, the installation of the upper mechanism onto the busbar may cause minor paint imperfections on the top part of the box. These imperfections are solely cosmetic and do not affect the electrical or mechanical performance of the product.


### **Fixing Elements**



### **Application I: TMP Ceiling Support with Snap-In Fixing Unit**

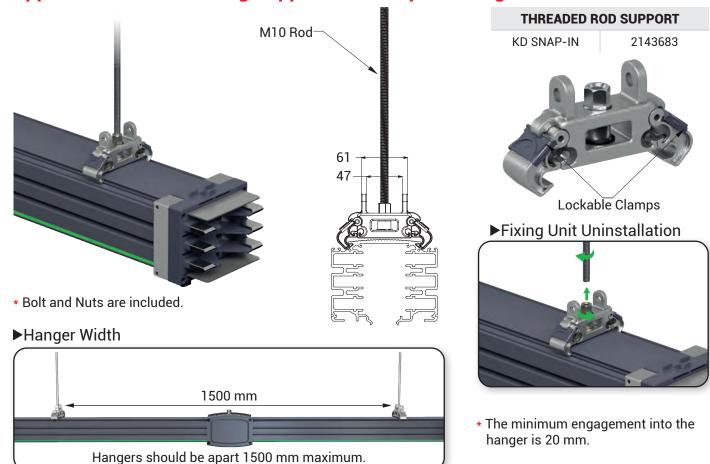

### **Application II: TMP Ceiling Support with Snap-In Fixing Unit**

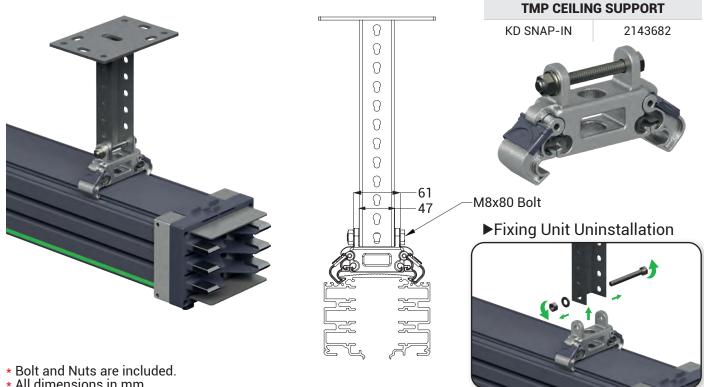


\* All dimensions in mm.

### **Fixing Elements**



### **Application III: TMP Ceiling Support and Tray Bracket with Snap-In Fixing Unit**

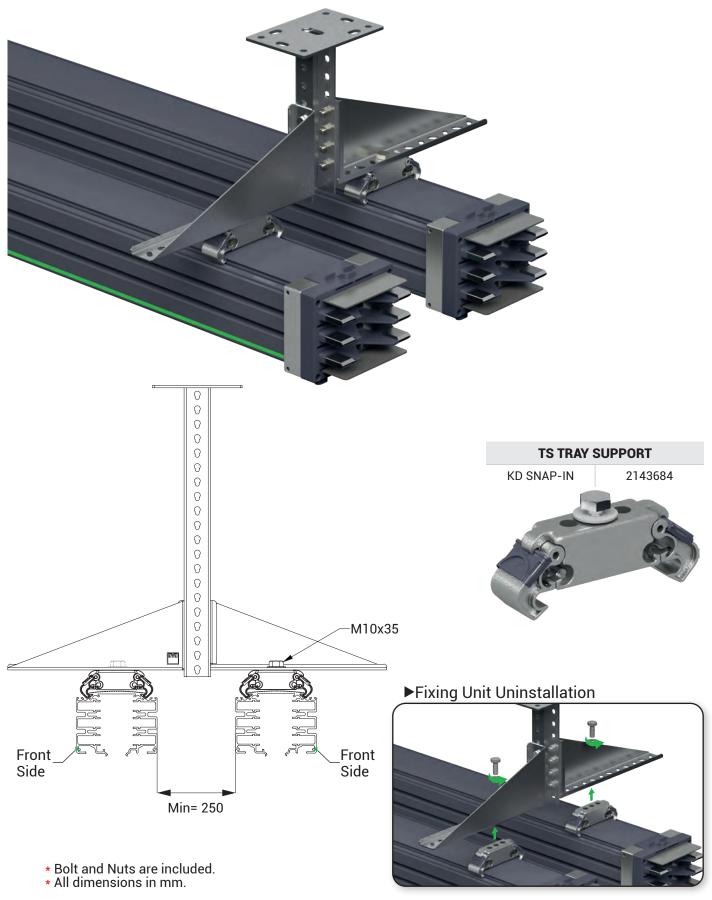


### **Fixing Elements**



### **Ceiling Mounting Fittings**


Hot Dip Galvanized After Fabrication (TS EN ISO 1461)

•						
Description	L (mm)	T (mm)	Pulling Load (kg.)	Weight Order (kg./pc.) Code		Pack (pc.)
TMP 42 Ceiling Support Unit	250	2	500	0,542	3008233	20
TMP 43 Ceiling Support Unit	500	2	500	0,949	3008234	10
TMP 44 Ceiling Support Unit	1000	2	500	2,131	3008235	_
TMP 45 Ceiling Support Unit	2000	2	500	3,791	3007952	-

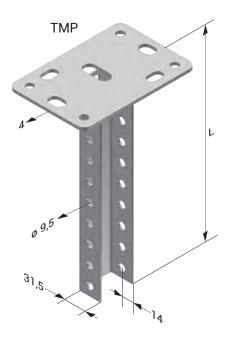

Tray Supports Hot Dip Galvanized After Fabrication (TS EN ISO 1461)

Description	A (mm)	T (mm)	Weight (kg./pc.)	Order Code	Pack (pc.)
TS 200	205	2	0,311	3008551	10
TS 250	255	2	0,521	3008549	10
TS 300	305	2	0,607	3008547	10
TS 400	405	2	0,781	3008545	10
TS 500	505	2	0,955	3008543	10
TS 600	605	2	1,128	3005828	10

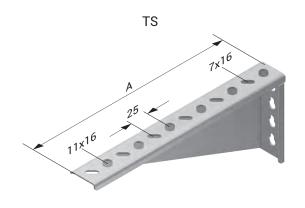

<sup>\*</sup> Please contact us for special size.

<sup>\*</sup> All dimensions in mm.


### **Fixing Elements**



### **Connection Accessories**

Description	L (mm)	Weight (kg./pc.)	Order Code
Threaded Rod (M10)	500	0,245	5000037
Threaded Rod (M10)	1000	0,490	5000032
Threaded Rod (M10)	1500	0,735	5000031
Threaded Rod (M10)	2000	1,030	5000030
Threaded Rod (M10)	3000	1,520	5000029
Threaded Rod (M10) Electro Galvanized	500	0,245	5000172
Threaded Rod (M10) Electro Galvanized	1000	0,490	5000173
Threaded Rod (M10) Electro Galvanized	1500	0,735	5000174
Threaded Rod (M10) Electro Galvanized	2000	1,030	5000175
Threaded Rod (M10) Electro Galvanized	3000	1,571	5000301

M10 Rod




Description	Weight (kg./pc.)	Order Code
Extension Nut (M10) Lacquered	0,070	1004312

**Extension Nut** 



Description	Order Code
Horizontal KD Hanger Element	2185387



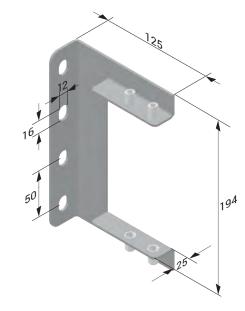

- \* Please contact us for special size. \* All dimensions in mm.


### **Measuring a Special Length**



After installation of standard busbar 3000 mm lengths, you will be in need of special lengths which are smaller than 3000 mm. The minimum length for these special elements can be 650 mm. Please measure the lengths of these modules as shown below.

Length A is measured between housing of 2 busbars in mm. A. The special length is calculated by deducting 97 mm from this measured length.

X=A-97 mm X=Length of Special Busbar (The busbar module will be manufactured as per X value.)

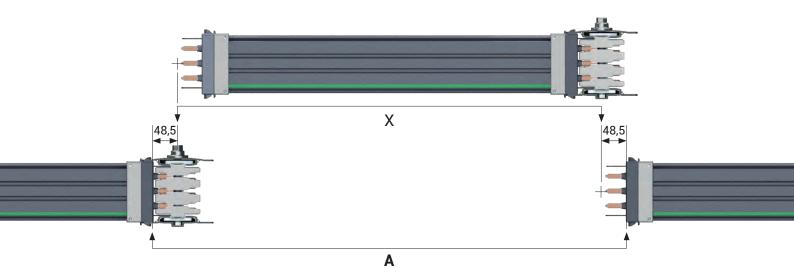

<sup>\*</sup> All dimensions in mm.

### **Busway Installation Applications**



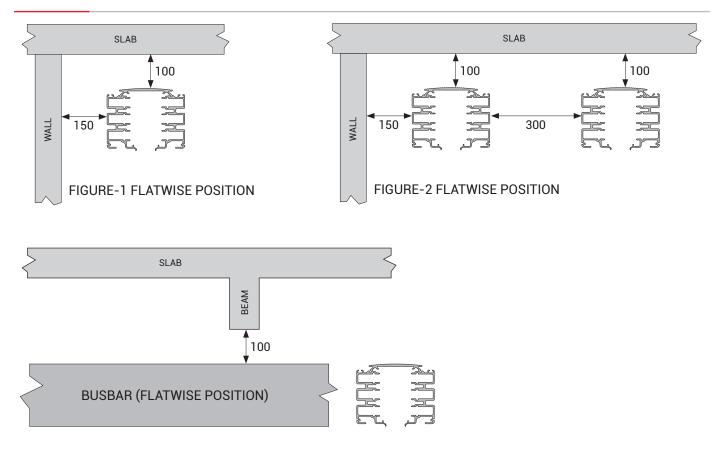


FIGURE-3 CROSSING UNDER A BEAM HORIZONTAL POSITION

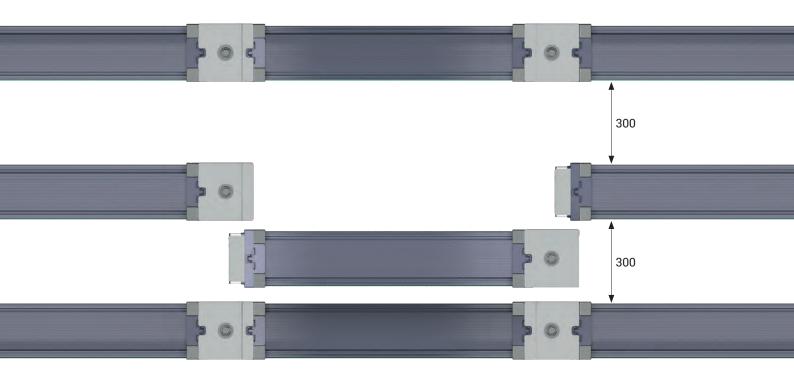


FIGURE-4 MINIMUM DISTANCE BETWEEN BUSBAR RUNS

\* All dimensions in mm.

### **Certificates**





#### **Declaration**



### **CE DECLARATION OF CONFORMITY**

Product Group E-Line KD Data Rack Busbar

Manufacturer EAE Elektrik Asansor End. Insaat San. ve Tic. A.S.

Akcaburgaz Mahallesi, 3114. Sokak, No:10 34522 Esenyurt-Istanbul-Turkey

The objects of the declaration described below is in conformity with the relevant Union harmonisation legislation. This declaration of conformity is issued under the sole responsibility of the manufacturer.

#### Standard:

TS EN 61439-6

Low-voltage switchgear and controlgear assemblies - Part 6: Busbar trunking systems

IEC 61439-6

Low-voltage switchgear and controlgear assemblies - Part 6: Busbar trunking systems (busways)

#### CE - Directive:

2014/35/EU "The Low Voltage Directive"

2014/30/EU "(EMC) Electromagnetic Compatibility Directive"

2011/65/EU "RoHS Directive"

#### **Technical Document Preparation Official:**

EAE Elektrik Asansor End. Insaat San. ve Tic. A.S. Akcaburgaz Mahallesi, 3114. Sokak, No:10 34522 Esenyurt-Istanbul

Mustafa AKÇELİK

Date

**Document Authorized Signatory** 

20.04.2024

Elif Gamze KAYA OK Deputy General Manager

#### **Product Overview**



#### 160A ... 1000A DATA RACK BUSBAR PRODUCT OVERVIEW (E-LINE KD)

#### Standards & Certification:

-Busbar system shall be designed and manufactured as per IEC 61439-6 standard, which requires below listed tests. Each busbar rating shall have a separate type test certificate from an independent internationally accredited laboratory including below tests:

10.2- Strength of material and parts, 10.2.2- Resistance to corrosion, 10.2.3- Properties of insulating materials, 10.2.3.1- Verification of thermal stability of enclosures, 10.2.3.2- Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects, 10.2.6- Mechanical impact, 10.2.7- Marking, 10.2.101- Ability to withstand mechanical loads, 10.2.101.1- Test procedure for a straight busbar trunking unit, 10.2.101.2- Test procedure for a joint, 10.2.101.3- Resistance of the enclosure to crushing, 10.3- Degree of protection of assembly, 10.4- Clearances and creepage distances, 10.5-Protection against electric shock and integrity of protective circuits, 10.5.2- Effective earth continuity between the exposed conductive parts of the assembly and the protective circuit, 10.5.3- Short-circuit withstand strength of the protective circuit, 10.9- Dielectric properties, 10.9.2- Power-frequency withstand voltage, 10.9.3- Impulse withstand

CC Fault-loop zero-sequences impedances, Annex DD Fault-loop resistances and reactances.

- Busbar system shall have CE marking.
- The manufacturer of busbar system shall have ISO 9001 and ISO 14001 certification.
- Each product shall have a "Type Label" including coding system, which identifies the brand, type of the unit, number of conductors and electrical details. The same coding shall be on the related certificate and catalogue.

voltage, 10.10- Verification of temperature rise, 10.11- Short- circuit withstand strength, Annex BB Phase conductor characteristics, Annex

#### **Electrical Characteristics**

- Busbar systems nominal insulation voltage shall be 1000 V.

-Conductors shall be packed and placed into the housing.

-Housing shall be made of thermal processed, extruded aluminium, RAL7012-Electrostatic painted.

#### 2.2- Conductors

Aluminium or Copper conductors overall isolated and tin plated.

- Aluminium conductors between 160A 630A.
- Copper conductors between 250A -1000A.
- Busbar system shall have the following number of conductors and wire configuration;
- 6 Conductors: (6 full size conductors CPE (100% earth conductor + double neutral + housing)),
   Phase conductors and neutral conductor shall have the same cross-section and they shall be insulated.
- Aluminium conductors shall be of EC grade aluminium. Minimum conductivity shall be 34m/mm².Ω.
- Copper conductors shall be minimum 99,95% electrolytic copper. Minimum conductivity shall be 56m/mm<sup>2</sup>.Ω.

Insulation system shall be suitable for 1.000V continuous operation. Conductor size shall be designed so that temperature rise on the conductors shall not exceed 100°C degree at nominal current, which helps to global heating problem. With this reason, insulation class shall be selected as "B class".

#### 2.4-Joint Structure

Electrical and mechanical connection shall be made by placing conductor joints into the joint blocks of the connected conductors and followed by tightening and fastening of the joint bolts.

#### 2.5-Protection

- Protection degree of the housing and joints shall be IP23D.

Busbar system shall have all necessary accessories (elbows, panel-transformer connections, etc.) Manufacturer shall supply special dimensioned units in short time, if the project conditions requires

- The Tap off boxes shall be Plug-nPlay type. Plug-n-Play tap off boxes shall be suitable to install or remove from busbars without switching off the power on the busbar.
- Plug-n-Play tap off boxes shall be suitable to install or remove anywhere alongside the busbar.
- The Tap-Off Box contacts shall be protected with a cover
- The Tap-Off contacts shall be heat cycle tested
- Contacts of plug-in tap off box shall be silver plated.
- The special locking mechanism of the Tap-Off Boxes shall ensure to carry the weight of the plug-in box and cables by the busbar housing While inserting the contacts of plug-in tap off box, earth contact shall make the first touch. While removing, it shall be disconnected last.
- Tap off boxes shall be manufactured of epoxy painted aluminium.
- The Tap-Off Boxes shall be equipped with a safe alignment mechanism to ensure correct installation and operation

#### 4-Busbar Fixing&Mounting System


- The Busbars shall be easily installed and positioned through their entire lengths with the "Snap-In Fixing Units" by inserting into the guiding slots on top of the housing.
- To ensure flexible positioning of the Busbars, each single busbar length shall easily slide independently on the "Snap-In Fixing Units" through the guiding slots.
- To maintain the mounting security, the "Snap-In Fixing Unit" clamps shall be lockable.
- For various mounting practices the "Snap-In Fixing Units" shall be available with threaded rod, ceiling support and/or with tray brackets options

#### 5-Installation and Commisioning

- Busbar systems shall be installed as per Single-Line drawings respect to required ampere rates and manufacturer installation guide (torque values, lockers, etc.). Electrical installer shall run an insulation test after installation, according to manufacturer's test procedures. The results of the test shall be reported to the manufacturer and minimum insulation value shall be 1 Mohms.


### Notes



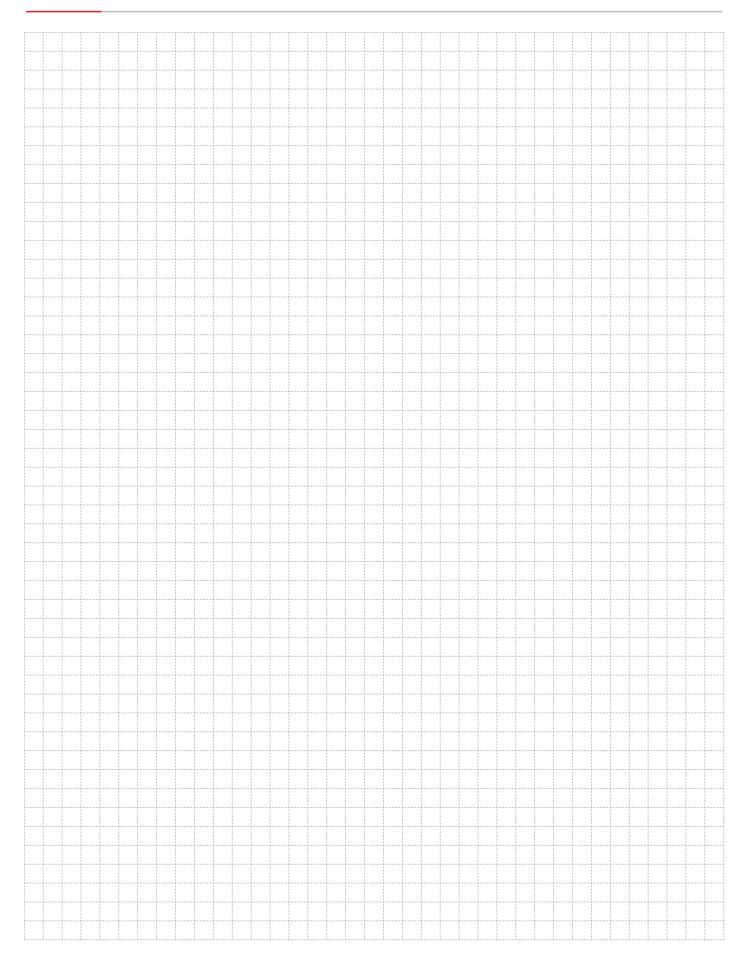

### Notes



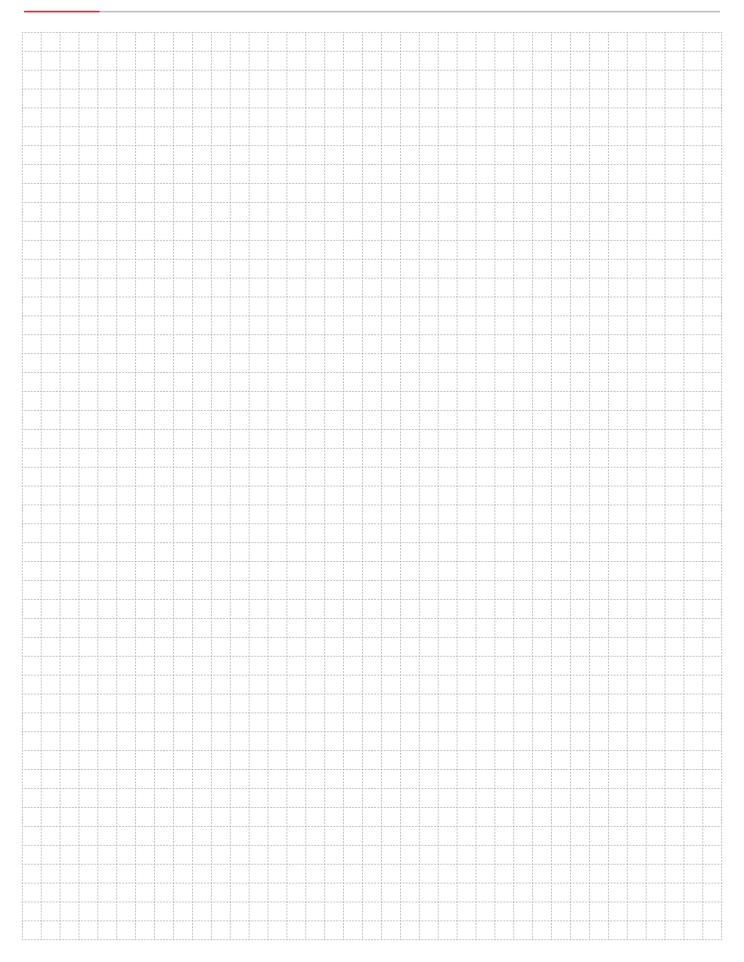

### SUSTAINABLE FUTURE

### Sustainability Management at EAE Elektrik



As part of our goal to support sustainable development and green transformation, measuring, evaluating, and managing all economic, environmental, and social impacts resulting from our sustainability practices is a key governance priority for EAE Elektrik. We act with great care in analyzing, monitoring, and managing the economic, environmental, and social impacts and risks that arise throughout our value chain in both our national and global operations.





#### **EAE Elektrik**

#### **Head Office**

Akcaburgaz Mahallesi, 3114. Sokak, No. 10 34522 Esenyurt - Istanbul - Turkiye Tel: +90 (212) 866 20 00 Fax: +90 (212) 886 24 20

#### **EAE DL 3 Factory**

Gebze IV Istanbul Makine ve Sanayicileri Organize Bolgesi, 6.Cadde, No:6 41455 Demirciler Koyu, Dilovasi - Kocaeli - Turkiye Tel: +90 (262) 999 05 55 Fax: +90 (262) 502 05 69

#### **EAE DL 4 Factory**

#### **Busbar 2**

Gebze IV Istanbul Makine ve Sanayicileri Organize Bolgesi, 6. Ćadde, No:14/10 41455 Demirciler Koyu, Dilovasi - Kocaeli - Turkiye Tel: +90 (262) 999 05 55 Fax: +90 (262) 502 01 45













